

Approval body for construction products
and types of construction

Bautechnisches Prüfamt

An institution established by the Federal and
Laender Governments



European Technical Assessment

ETA-15/0387
of 30 June 2023

English translation prepared by DIBt - Original version in German language

General Part

Technical Assessment Body issuing the
European Technical Assessment:

Deutsches Institut für Bautechnik

Trade name of the construction product

EJOT / SORMAT SDF 8V

Product family
to which the construction product belongs

Plastic anchor for redundant non-structural systems in
concrete and masonry

Manufacturer

EJOT SE & Co. KG
Astenbergstraße 21
57319 Bad Berleburg
DEUTSCHLAND

Manufacturing plant

EJOT manufacturing plant 1, 2, 3 and 4

This European Technical Assessment
contains

13 pages including 3 annexes which form an integral part
of this assessment

This European Technical Assessment is
issued in accordance with Regulation (EU)
No 305/2011, on the basis of

EAD 330284-00-0604 edition 12/2020

This version replaces

ETA-15/0387 issued on 27 August 2015

The European Technical Assessment is issued by the Technical Assessment Body in its official language. Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and shall be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may only be made with the written consent of the issuing Technical Assessment Body. Any partial reproduction shall be identified as such.

This European Technical Assessment may be withdrawn by the issuing Technical Assessment Body, in particular pursuant to information by the Commission in accordance with Article 25(3) of Regulation (EU) No 305/2011.

Specific part

1 Technical description of the product

The frame fixing EJOT / SORMAT SDF 8V is a plastic anchor consisting of a plastic sleeve made of polyamide and an accompanying specific screw of galvanised steel, of galvanised steel with additional organic coating or of stainless steel.

The plastic sleeve is expanded by screwing in the specific screw which presses the sleeve against the wall of the drilled hole.

The product description is given in Annex A.

2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchors of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

3 Performance of the product and references to the methods used for its assessment

3.1 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Class A1
Resistance to fire	See Annex C 1

3.2 Mechanical resistance and stability (BWR 4)

Essential characteristic	Performance
Resistance to steel failure under tension loading	See Annex C 1
Resistance to steel failure under shear loading	See Annex C 1
Resistance to pull-out or concrete failure under tension loading (base material group a)	See Annex C 1
Resistance in any load direction without lever arm (base material group b)	See Annexes C 2
Edge distance and spacing (base material group a)	See Annex B 2
Edge distance and spacing (base material group b)	See Annex B 3
Displacements under short-term and long-term loading	See Annex C 1
Durability	See Annex B 1

English translation prepared by DIBt

4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with European Assessment Document EAD 330284-00-0604 the applicable European legal act is: 97/463/EC.

The system to be applied is: 2+

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Technical details necessary for the implementation of the AVCP system are laid down in the control plan deposited with Deutsches Institut für Bautechnik.

Issued in Berlin on 30 June 2023 by Deutsches Institut für Bautechnik

Dipl.-Ing. Beatrix Wittstock
Head of Section

beglaubigt:
Ziegler

Intended use

Anchorage in concrete and solid bricks

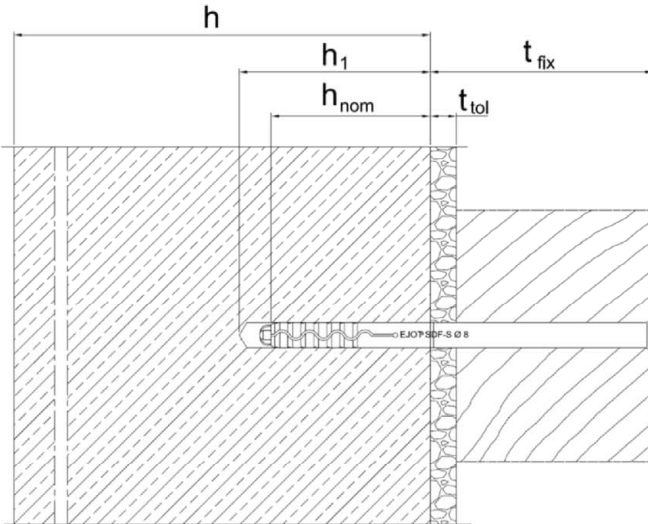


Figure 1: Intended use: screw head type: countersunk (S)

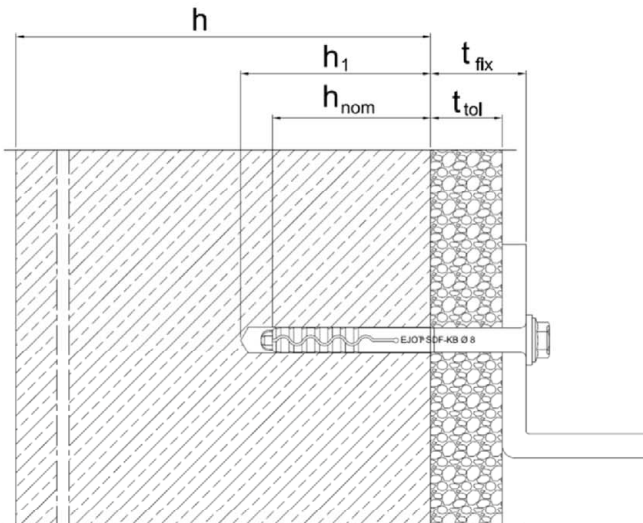


Figure 2: Intended use: screw head type: hexagon head with collar (KB)

Legend


- h = Thickness of member
- h_1 = Depth of drilled hole to deepest point
- h_{nom} = Overall plastic anchor embedment depth in base material (setting depth)
- t_{tol} = Thickness of equalizing layer or non-load bearing coating
- t_{fix} = t_{tol} + thickness of fixture

EJOT / SORMAT SDF 8V

Product description
Installed condition

Annex A 1

Anchor sleeve

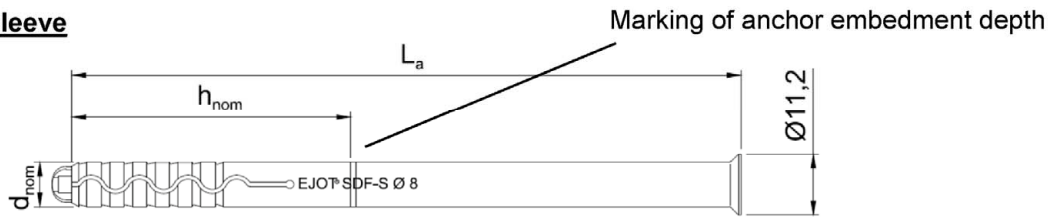

Special screw

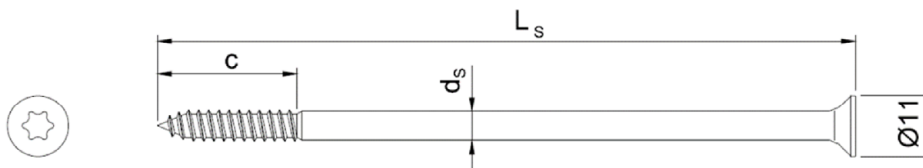


Figure 1: Type of anchor: countersunk (S)

Anchor marking:


Manufacturer, anchor type incl. head type, diameter, length

Example: EJOT SDF-S-8 x 100

Screw marking:

Length of anchor (e.g. 100)

Anchor sleeve

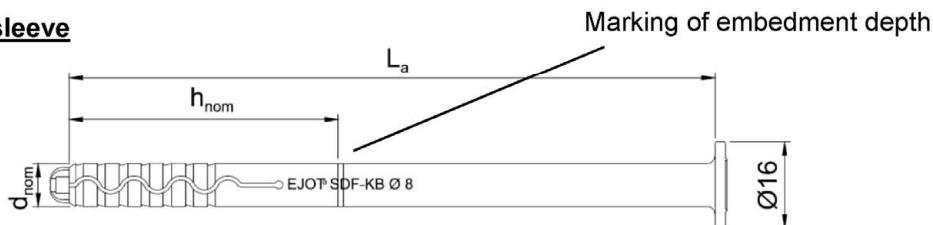

Special screw

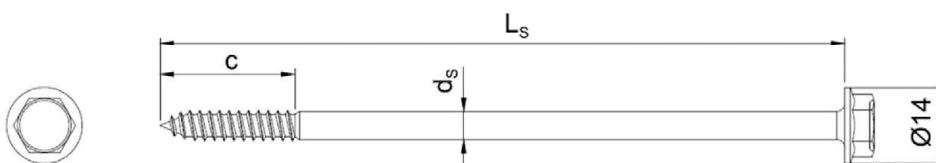


Figure 2: Type of anchor: collar with flange (KB)

Anchor marking:

Manufacturer, anchor type incl. head type, diameter, length

Example: EJOT SDF-KB-8 x 100

Screw marking:

Length of anchor (e.g. 100)

EJOT / SORMAT SDF 8V

Product description

Anchor types, marking of the anchor sleeve and special screw

Annex A 2

Product designation key

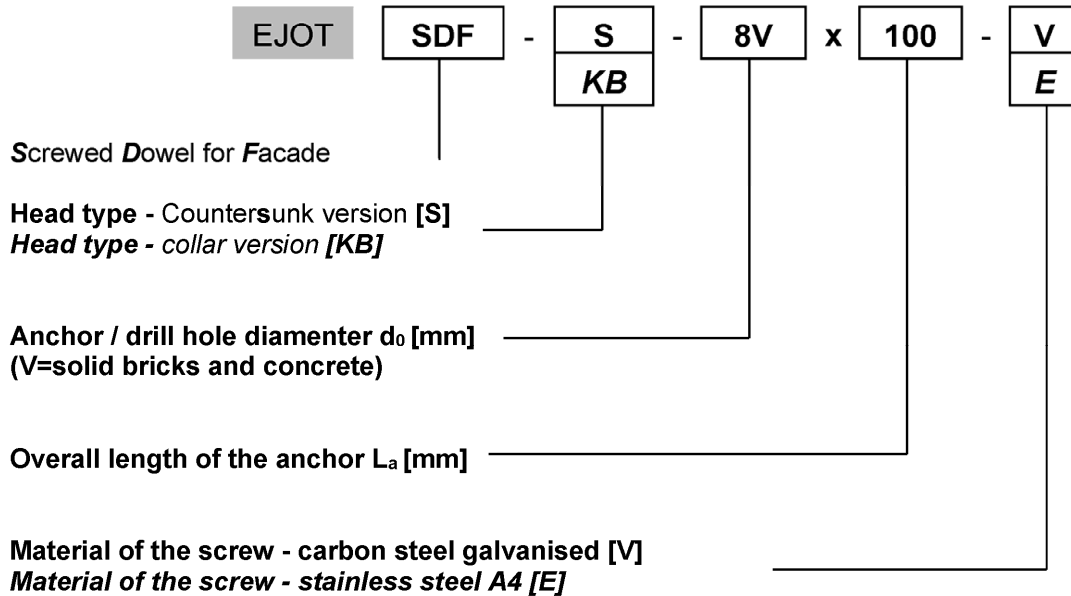


Table A3.1: Dimensions [mm]

Anchor type	Anchor sleeve					Special screw		
	colour	d_{nom}	h_{nom}	min L_a	max L_a	L_s	d_s	c
SDF – KB – 8V	red	8	50	60	220	$L_a + 8,0$	5,2	25
SDF – S – 8V	red	8	50	60	220	$L_a + 8,0$	5,2	25

Designations: see Annex A 2

Table A3.2: Materials

Element	Material
Anchor sleeve	Polyamid PA6, colour see Table A3.1
Special screw	Steel, galvanized zinc plated > 5 μm acc. EN ISO 4042:2018
	Steel, galvanized zinc plated > 5 μm acc. EN ISO 4042:2018 with additional organic coating (C1000)
	Stainless steel of corrosion resistance class CRC III in accordance EN 1993-1-4:2006 + A1:2015

EJOT / SORMAT SDF 8V

Product description
Product designation key, dimensions and material

Annex A 3

Specifications of intended use

Anchorage is subject to:

- static or quasi-static loads
- Redundant non-structural systems

Base materials:

- Reinforced or unreinforced compacted normal weight concrete without fibres with strength classes \geq C12/15 (base material group a), in accordance with EN 206:2013+A1:2016, Annex C 2
- Solid brick masonry (base material group b) according to Annex C 3.
Note: The characteristic resistance is also valid for larger brick sizes and larger compressive strength of the masonry unit.
- Mortar strength class of the masonry \geq M2,5 in accordance with EN 998-2:2010.
- For other base materials of the base material groups a and b the characteristic resistance of the anchor may be determined by job site tests in accordance with TR 051:2018-04.

Temperature Range:

- c: -5°C to 50°C (max. short term temperature +50°C and max. long term temperature +30°C)
- b: -5°C to 80°C (max. short term temperature +80°C and max. long term temperature +50°C)

Use conditions (Environmental conditions):

- Structures subject to dry internal conditions (zinc coated steel, stainless steel).
- The specific screw made of galvanized steel may also be used in structures subject to external atmospheric exposure, if the area of the head of the screw is protected against moisture and driving rain after mounting of the fixing unit in this way, that intrusion of moisture into the anchor shaft is prevented. Therefore there shall be an external cladding or a ventilated rainscreen mounted in front of the head of the screw and the head of the screw itself shall be coated with a soft plastic, permanently elastic bitumen-oil-combination coating (e.g. undercoating or body cavity protection for cars).
- Structures subject to external atmospheric exposure (including industrial and marine environment) and to permanently damp internal condition, if no particular aggressive conditions exist (stainless steel).
- Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used).

Design:

- The anchorages are designed in accordance with TR 064:2018-05 under the responsibility of an engineer experienced in anchorages and masonry work.
- Verifiable calculation notes and drawings shall be prepared taking account of the loads to be anchored, the nature and strength of the base materials and the dimensions of the anchorage members as well as of the relevant tolerances. The position of the anchor is indicated on the design drawings.

Installation:

- Hole drilling by the drill modes acc. to Annex C for base material group a and b.
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters on site.
- Installation temperature from -5°C to +40°C
- Exposure to UV due to solar radiation of anchor not protected \leq 6 weeks
- No ingress of water in the borehole at temperatures < 0 °C.

EJOT / SORMAT SDF 8V

Intended use
Specifications

Annex B 1

Table B2.1: Installation parameters

Anchor type			SDF-KB-8V SDF-S-8V
Base material group ¹⁾			a,b
Drill hole diameter	d_0 [mm]	=	8
Cutting diameter of drill bit	d_{cut} [mm]	≤	8,45
Depth of the drill hole to deepest point	h_1 [mm]	≥	60
Overall embedment depth of the anchor in the base material ¹⁾	h_{nom} [mm]	≥	50
Diameter of the clearance hole in the fixture	d_f [mm]	≤	8,5
Thickness of fixture	t_{fix} [mm]	≥	10
Minimum temperature during installation process	[°C]		-5
Temperature range (c)	[°C]		30 - 50
Temperature range (b)	[°C]		50 - 80

¹⁾ Base material group a = concrete, b = solid masonry


Table B2.2: Minimum member thickness, edge distance and spacing in concrete (base material group a)

Compressive strength	Minimum member thickness h_{min} [mm]	Characteristic edge distance $c_{cr,N}$ [mm]	Characteristic spacing a [mm]	Minimum edge distance c_{min} [mm]	Minimum spacing s_{min} [mm]
≥ C16/20	100	100	100	50	80
≥ C12/15	100	140	115	70	110

Fixing point with a spacing $\leq a$ are considered as a group with max. characteristic resistance $N_{Rk,p}$ according to Table C1.3.

For a spacing $> a$ the anchors are always considered as single anchors, each with a characteristic resistance $N_{Rk,p}$ according to Table C1.3.

Scheme of distance and spacing in concrete

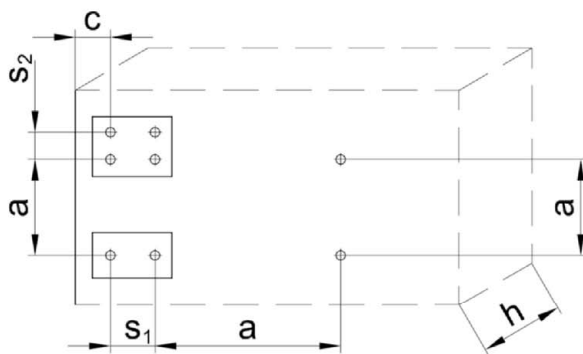

- h = member thickness
- c = edge distance
- a = spacing
- s = spacing within an anchor group

EJOT / SORMAT SDF 8V

Intended use


Installation parameters, minimum member thickness, spacing and edge distance in concrete

Annex B 2

**Table B3.1: Minimum member thickness, spacing and edge distance in solid bricks
(base material group b)**

Base material	Minimum member thickness h_{min} [mm]	Single anchor		Anchor group		
		Minimum edge distance c_{min} [mm]	Minimum spacing s_{min} [mm]	Minimum edge distance c_{min} [mm]	Minimum spacing $s_{1,min}$ [mm]	Minimum spacing $s_{2,min}$ [mm]
771 1-007 Mz	70	100	250	100	80	80
771 2-008 KS	70	100	250	100	80	80

Scheme of spacing and edge distances in masonry

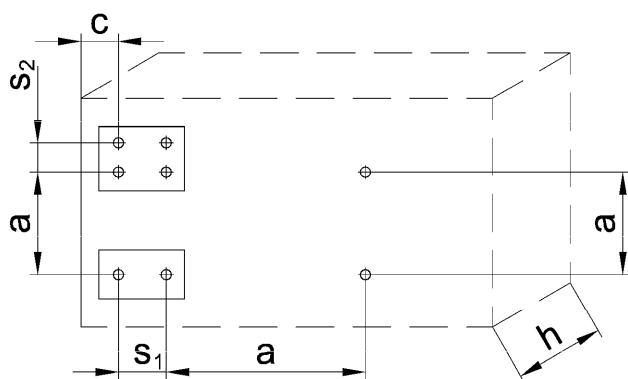

- h = member thickness
- c = edge distance
- a = spacing
- s_1 = spacing (perpendicular to the free edge) within an anchor group
- s_2 = spacing (parallel to the free edge) within an anchor group


EJOT / SORMAT SDF 8V

Intended use
Minimum member thickness, spacing and edge distance in solid bricks

Annex B 3


Installation instructions (exemplary for the fixing of a pre-drilled metal attachment part)

Drill the bore hole \varnothing 8 mm using the drill method described in Annex C

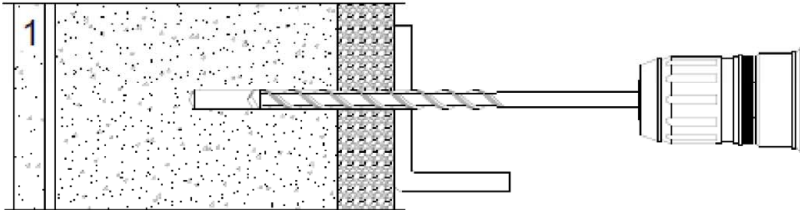


Cleaning of the hole


Insert the assembled anchor (screw and sleeve) using a hammer, until the plastic sleeve is flush with the surface of fixture

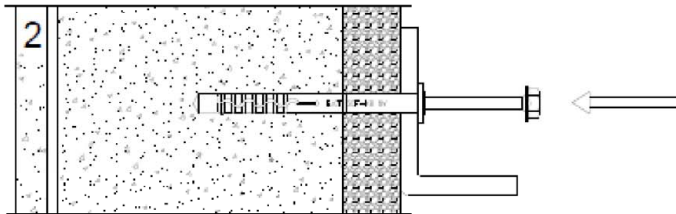

Screw in the screw, until the head of the screw touches the plastic sleeve

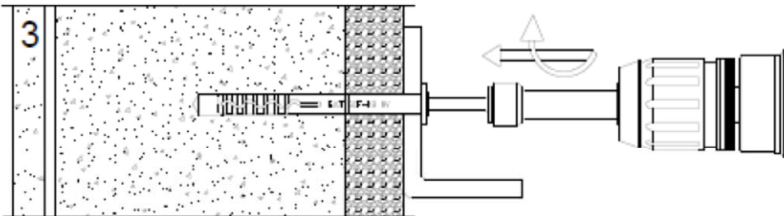

Correctly installed anchor

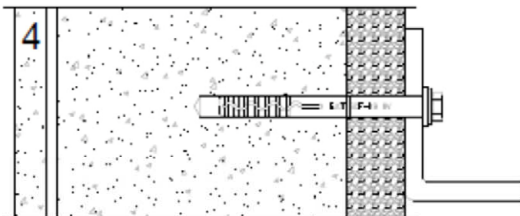

EJOT / SORMAT SDF 8V

Intended use
Installation instructions

Annex B 4

Table C1.1: Characteristic resistance of the screw

Steel failure of the special screw		SDF-8V	
Material		Galvanized steel	Stainless steel
Characteristic tension resistance	$N_{Rk,s}$ [kN]	10,62	14,87
<i>Partial safety factor γ_{Ms}</i> ¹⁾		1,4	1,4
Characteristic shear resistance	$V_{Rk,s}$ [kN]	5,3	7,4
Characteristic bending moment	$M_{Rk,s}$ [Nm]	8,2	11,6
<i>Partial safety factor γ_{Ms}</i> ¹⁾		1,25	1,56

¹⁾ in absence of other national regulations

Table C1.2: Displacements¹⁾²⁾ under tension and shear loading in concrete and solid masonry

Anchor type	Tension or shear load	Displacements under tension		Displacements under shear	
		δ_{N0} [mm]	$\delta_{N\infty}$ [mm]	δ_{V0} [mm]	$\delta_{V\infty}$ [mm]
SDF-8V	F = N = V [kN]				
	2,6	0,75	1,5	1,83	2,75

¹⁾ Valid for all temperature ranges

²⁾ Intermediate values by linear interpolation

Table C1.3: Characteristic resistance in concrete

Pull-out failure	Characteristic resistance
Characteristic tension resistance $N_{Rk,p}$ ²⁾ [kN]	< C20/25
Characteristic tension resistance $N_{Rk,p}$ ²⁾ [kN]	\geq C20/25
<i>Partial safety factor γ_{Mc}</i> ¹⁾	1,8

¹⁾ in absence of other national regulations

²⁾ valid in temperature ranges c and b

Table C1.4: Values under fire exposure in concrete C20/25 to C50/60 in any load direction, no permanent centric tension load and without lever arm, fastening of façade systems (Fire resistance class R 90)

Characteristic tension resistance $F_{Rk,fi,90}$ [kN]	$\leq 0,8$
<i>Partial safety factor $\gamma_{M,fi}$</i> ¹⁾	1,0

¹⁾ in absence of other national regulations

EJOT / SORMAT SDF 8V

Performances

Characteristic resistance of the screw, characteristic resistance in concrete, displacements under tension and shear loads, values under fire exposure

Annex C 1

Table C2.1: Characteristic resistance F_{Rk} in solid masonry

Base material	Minimum stone format (LxWxH) [mm]	Drilling method	Minimum compressive strength f_b [N/mm ²]	c_{min} [mm]	$F_{Rk}^{3)}$ [kN]
Vollsteinmauerwerk					
Clay brick Mz NF 28-1.8 (EN 771-1:2011+A1:2015) 771 1-007 Mz	240x115x71	H ¹⁾	28	100	2,0
			20		2,0
			10		1,2
Sand-lime solid brick KS NF 12-2.0 (EN 771-2:2011+A1:2015) 771 2-008 KS	240x115x71	H ¹⁾	20	250	2,5
			10		1,5
<i>Partial safety factor $\gamma_{Mc}^{2)}$</i>					2,5

1) H = Hammerdrilling

2) In absence of other national regulations

3) Temperature range b and c

EJOT / SORMAT SDF 8V

Performances
Characteristic resistance in solid masonry

Annex C 2